



Cert. No. LRQ 0963008

ISO 9001

spirax sarco

ADV

TI-P509-07
CH Issue 1

Spirax-Monnier Automatic Drain Valve

Typical installations

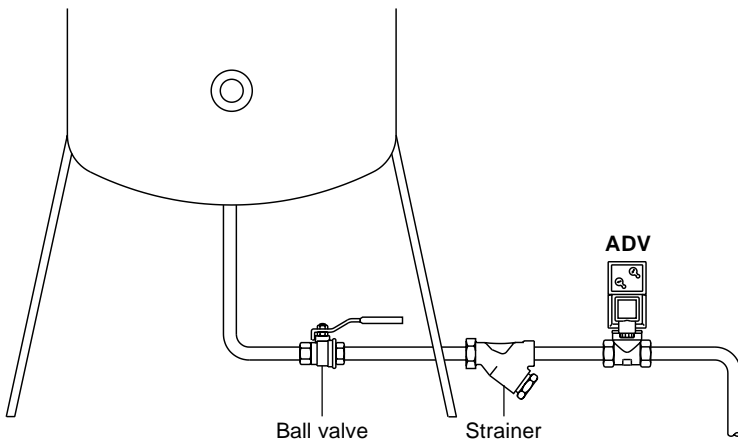


Fig. 1 Draining a receiver or large filter

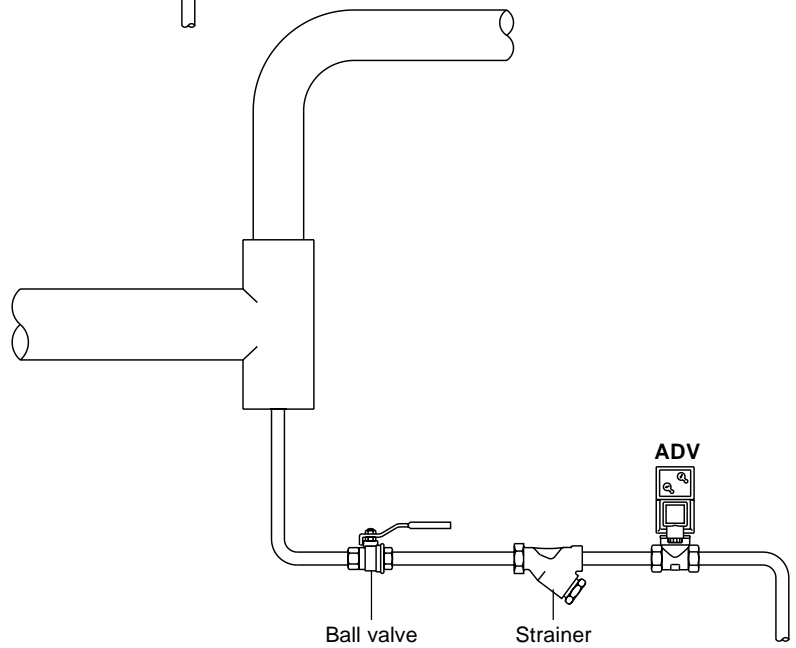


Fig. 2 Draining a compressed air main relay point

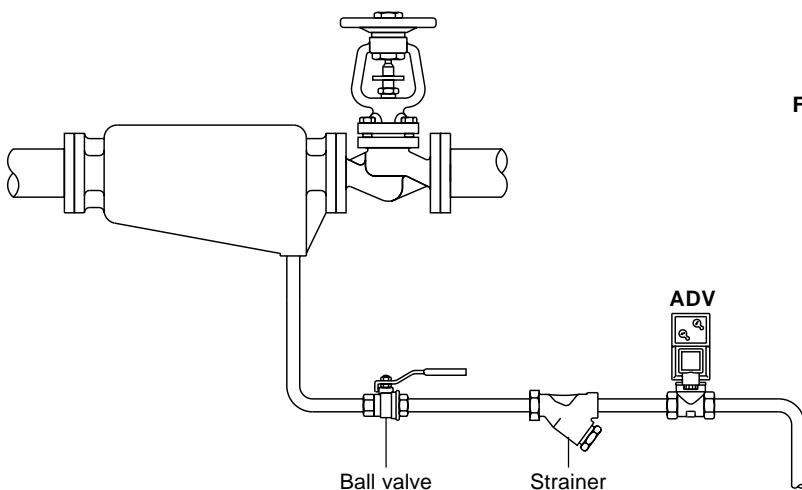


Fig. 3 Draining a separator on a compressed air main